

April 2005

Description

The HCS HART Concentrator System converts a HART digital signal to a serial (RS-485) MODBUS RTU communication protocol. This allows HART transmitters and valves to interface directly with MODBUS-based monitoring and control systems.

Operates in Point-to-Point and Digital Multidrop HART Networks


In point-to-point HART mode, the HCS is set to monitor a single instrument. All process and diagnostic data carried on the HART data string is converted to MODBUS RTU.

Up to 16 HART Devices Per HCS—In a digital multidrop HART network, up to 16 HART instruments digitally communicate on the same wires. The HCS can be set to monitor any or all instruments and/or valves within the network. Only one MODBUS address, and one communication link (such as twisted wire pair), is needed to send the process and diagnostic data from up to 16 HART devices to a MODBUS host.



The HCS features a metal, RFI resistant housing that snaps onto standard DIN-style rails.


Figure 1. The HCS economically converts HART to serial MODBUS RTU (RS-485) protocol.

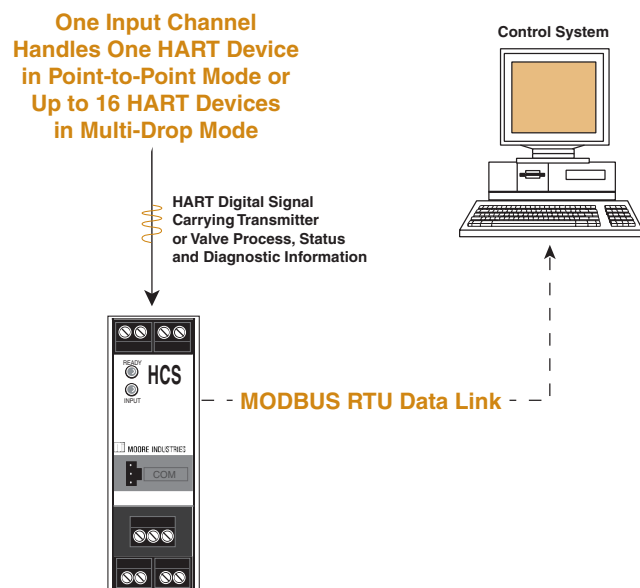

Features

- Works with every HART-compatible device.**
 The HCS handles smart multivariable mass flow, pressure, pH and temperature transmitters; coriolis, magnetic, ultrasonic and vortex flow meters; radar and hydrostatic level transmitters; and valve positioners and damper operators.
- Monitor primary and non-primary variables.**
 All HART process information, including primary, second, third and fourth process variable data is converted to MODBUS RTU and available to the MODBUS host system.
- Monitor HART instrument diagnostics.** Using the Field Device Status Byte data that is available in HART's digital information, the HCS can transmit, via MODBUS RTU, diagnostic data including smart device configuration changed; primary and non-primary variables out of limits; primary variable analog output fixed; cold start; field device malfunction; and more HART status data available.
- PC-programmable with Windows® software.**
 From a single screen, you can choose, and then view to confirm, all of your application specific operating parameters from a PC.

Certifications

 CE Conformant – EMC Directive 89/336/EEC
EN 61326

* HART is a registered trademark of the HART Communication Foundation

HCS

HART® Concentrator System
HART-to-MODBUS RTU Converter

Specifications

Performance **Input Accuracy:** Reflects the accuracy of the HART field device
Input Impedance:
Transmit Mode: 150 ohms;
Receive Mode: Less than 5 kohms
Input Over-Range Protection: $\pm 5V_{dc}$
Isolation: 1000Vrms between case, input, output and power terminals and will withstand 1500Vac dielectric strength test for one minute continuous with no breakdown
Power Supply: 24Vdc, nominal; 20-30Vdc maximum
+TX Power Supply: 23.2Vdc $\pm 3\%$ @ 24mA
Digital Response Time: Equals the combination of the HART response time and the MODBUS response time; the HART delay is defined by the HART protocol as 500msec in normal mode and 333msec in burst mode; the MODBUS response time depends on how fast and how often a MODBUS Master requests data from the HCS; the data request to response time is 50msec


Performance (Continued) **Output Type:** Standard MODBUS RTU protocol interface over RS-485 (parameters as specified in U.S. Standard EIA-RS485)
Output Protection: Transient protection on output
Address Range: Configurable from 1 to 247. Unit will assume a MODBUS address of 01 by default
Baud Rate: Interface supports the following: 300, 600, 1200, 2400, 4800, 9600 and 19.2k. MODBUS interface will support even, odd and no parities. Unit will assume a baud rate of 9600 and no parity by default
Character Format: One start bit, 8 data bits and one stop bit
Data Format: User-selectable Standard LSW (Least Significant Word) or Swapped MSW (Most Significant Word). Unit will assume Standard LSW by default
Power Consumption: 1.5W, nominal; 2W @ 24Vdc maximum for units using transmitter excitation to supply loop power to a 2-wire instrument

Indicators **LED Type:** Dual color red/green indicate:
INPUT LED: Input is present and normal (green); input signal is not found (red)
READY LED: Instrument is ready for operation and configuration (green); instrument has encountered an internal problem (red)

Ambient Operating & Storage Conditions **Range:** -40°C to +85°C (-40°F to +185°F)
Relative Humidity: 0-95%, non-condensing
RF/EMI Immunity (Standard): 10V/m @ 80-1000MHz, 1kHz AM, when tested according to IEC61326 with error of 0.5% of span or less
RF/EMI Immunity (with -RF Option): 20V/m @ 80-1000MHz, 1kHz, when tested according to IEC61326 with error of 0.5% of span or less
Noise Rejection: Common Mode: 100dB @ 50/60Hz

Weight 290 g (10.2 oz)

Figure 2. Only one communication link, and one MODBUS RTU address, are needed to send the process and diagnostic data from up to 16 HART devices long distances to a host computer-based system.

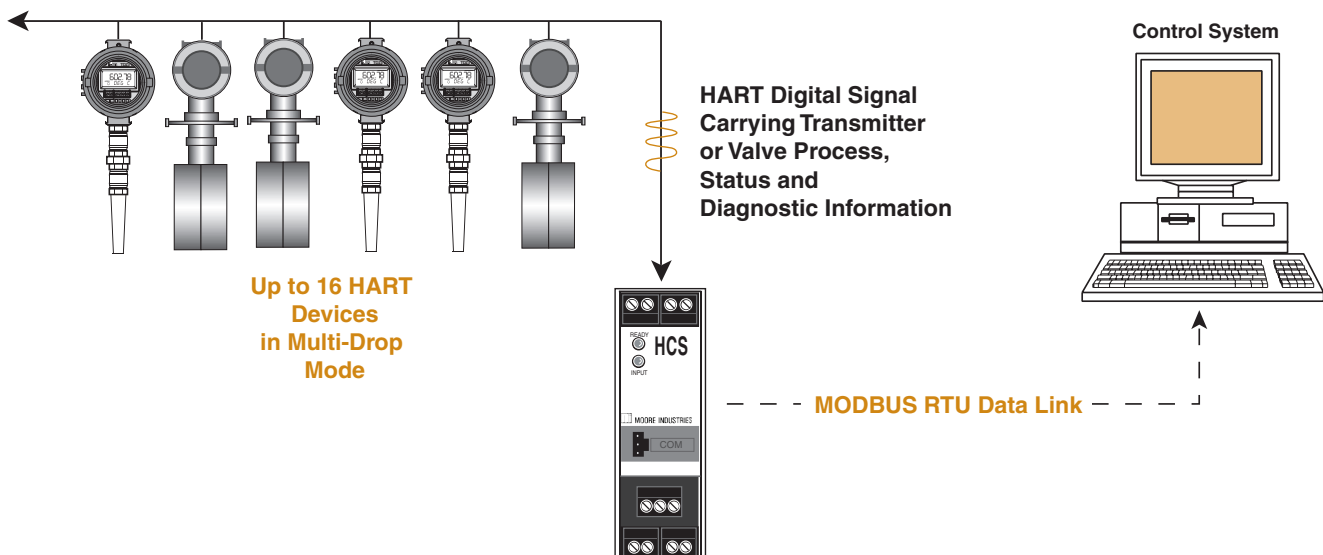

Ordering Information

Unit	Input	Output	Power	Options	Housing
HCS HART Concentrator System	HART Accepts a HART digital protocol input directly from a smart HART transmitter or from a valve positioner	MB MODBUS RTU (RS-485) serial data link	24DC ±10%	-RF Enhanced RFI/EMI protection (see "Specifications" for details)	DIN Universal DIN-style housing mounts on 32mm (EN50035) G-type and 35mm (EN50022) Top Hat DIN-rails

To order, specify: Unit / Input / Output / Power / Options [Housing]

Model Number Example: HCS / HART / MB / 24DC / -RF [DIN]

Accessories

Each HCS order comes with one copy of our Intelligent PC Configuration Software (Windows® '95, '98, 2000, NT and XP compatible) and a configuration cable. Use the chart below to order additional parts.

Part Number 750-75E05-01	HCS Intelligent PC Configuration Software (One copy provided free with each order)
Part Number 803-053-26	HCS Configuration Cable for use in connecting the HCS to the PC (one cable provided free with each order)

Powers a 2-Wire Transmitter

The HCS can provide transmitter excitation (24Vdc loop power) to one 2-wire transmitter it is monitoring. This saves the cost of specifying and installing an additional instrument power supply.


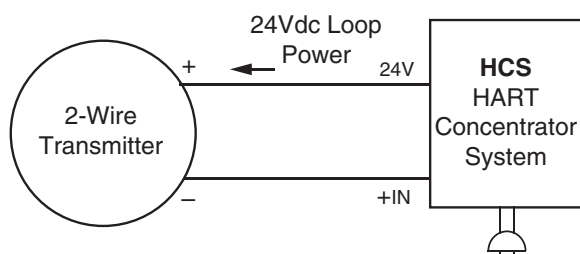


Figure 3. In just minutes, you can set up the HCS using our single window Intelligent PC Configuration Software.

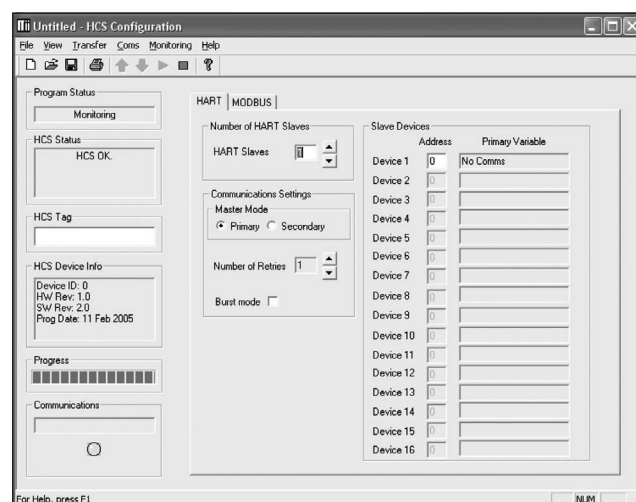

PC-Programmable in Minutes

All operating parameters configure quickly and easily using our Intelligent PC Configuration Software. Configurations can be saved, and quickly downloaded to other HART Concentrator modules.

Programmable functions include:

- **HART Parameters**—Instrument (HART) address to monitor, Normal or Burst mode, and Primary/Secondary Master.
- **MODBUS Parameters**—MODBUS address, baud rate, parity, floating point word order and register grouping.

HCS

HART® Concentrator System
HART-to-MODBUS RTU Converter

Figure 4. Installation Dimensions

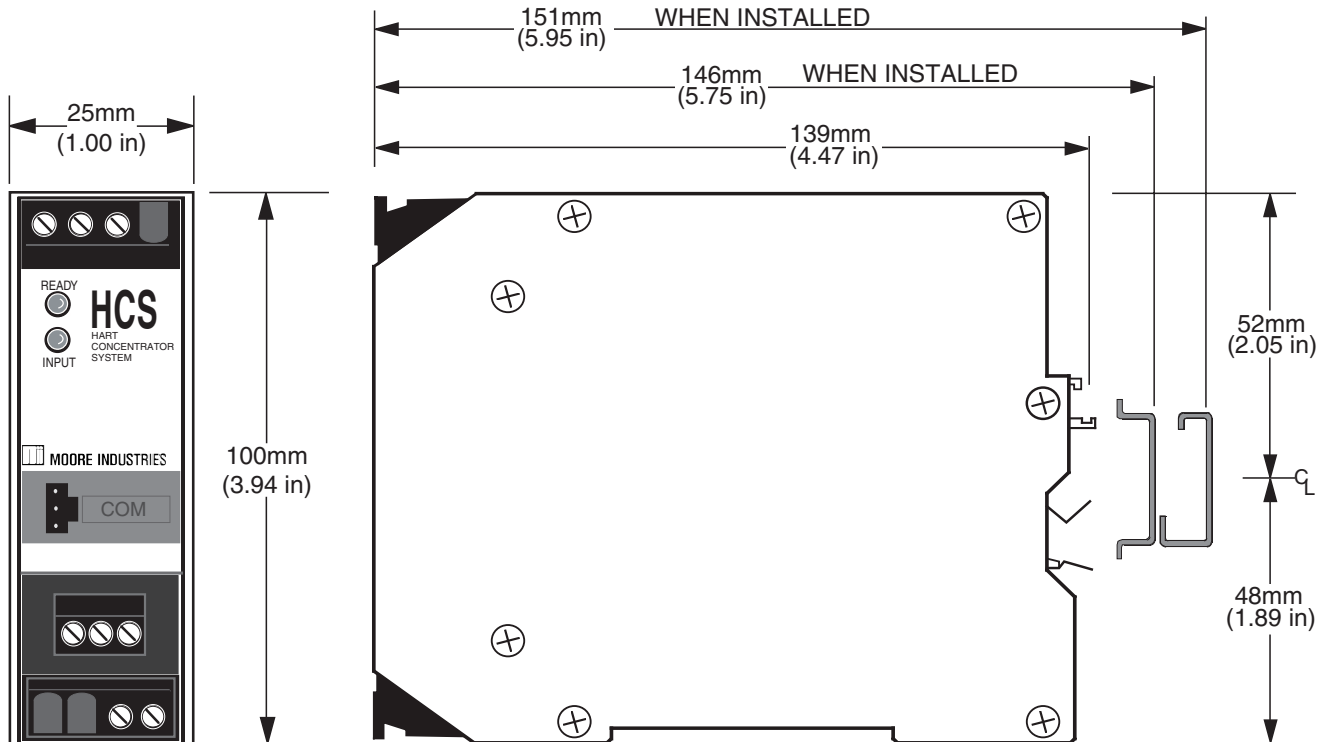


Table 1. Terminal Designations

Input	Top Terminals (Left to Right)			
	T1	T2	T3	T4
	+TX	+IN	-IN	Not Used

MODBUS Output	Middle Terminals (Left to Right)		
	M1	M2	M3
	A	B	S

Power	Bottom Terminals (Left to Right)			
	B1	B2	B3	B4
	Not Used	Not Used	+	-

KEY:	
+TX = Power for 2-Wire transmitter	A = A MODBUS
+IN = Positive input	B = B MODBUS
-IN = Negative input	S = S MODBUS
	+ = Positive power input
	- = Negative power input

NOTE:

1. Terminal blocks can accommodate 14-22 AWG solid wiring.
2. Tighten terminals to four inch-pounds (maximum).



The Interface Solution Experts • www.miinet.com
 United States • info@miinet.com
 Tel: (818) 894-7111 • FAX: (818) 891-2816
 Australia • sales@mooreind.com.au
 Tel: (02) 8536-7200 • FAX: (02) 9525-7296

Belgium • info@mooreind.be
 Tel: 03/448.10.18 • FAX: 03/440.17.97
 The Netherlands • sales@mooreind.nl
 Tel: (0)344-617971 • FAX: (0)344-615920

China • sales@mooreind.sh.cn
 Tel: 86-21-62481120 • FAX: 86-21-62490635
 United Kingdom • sales@mooreind.com
 Tel: 01293 514488 • FAX: 01293 536852